

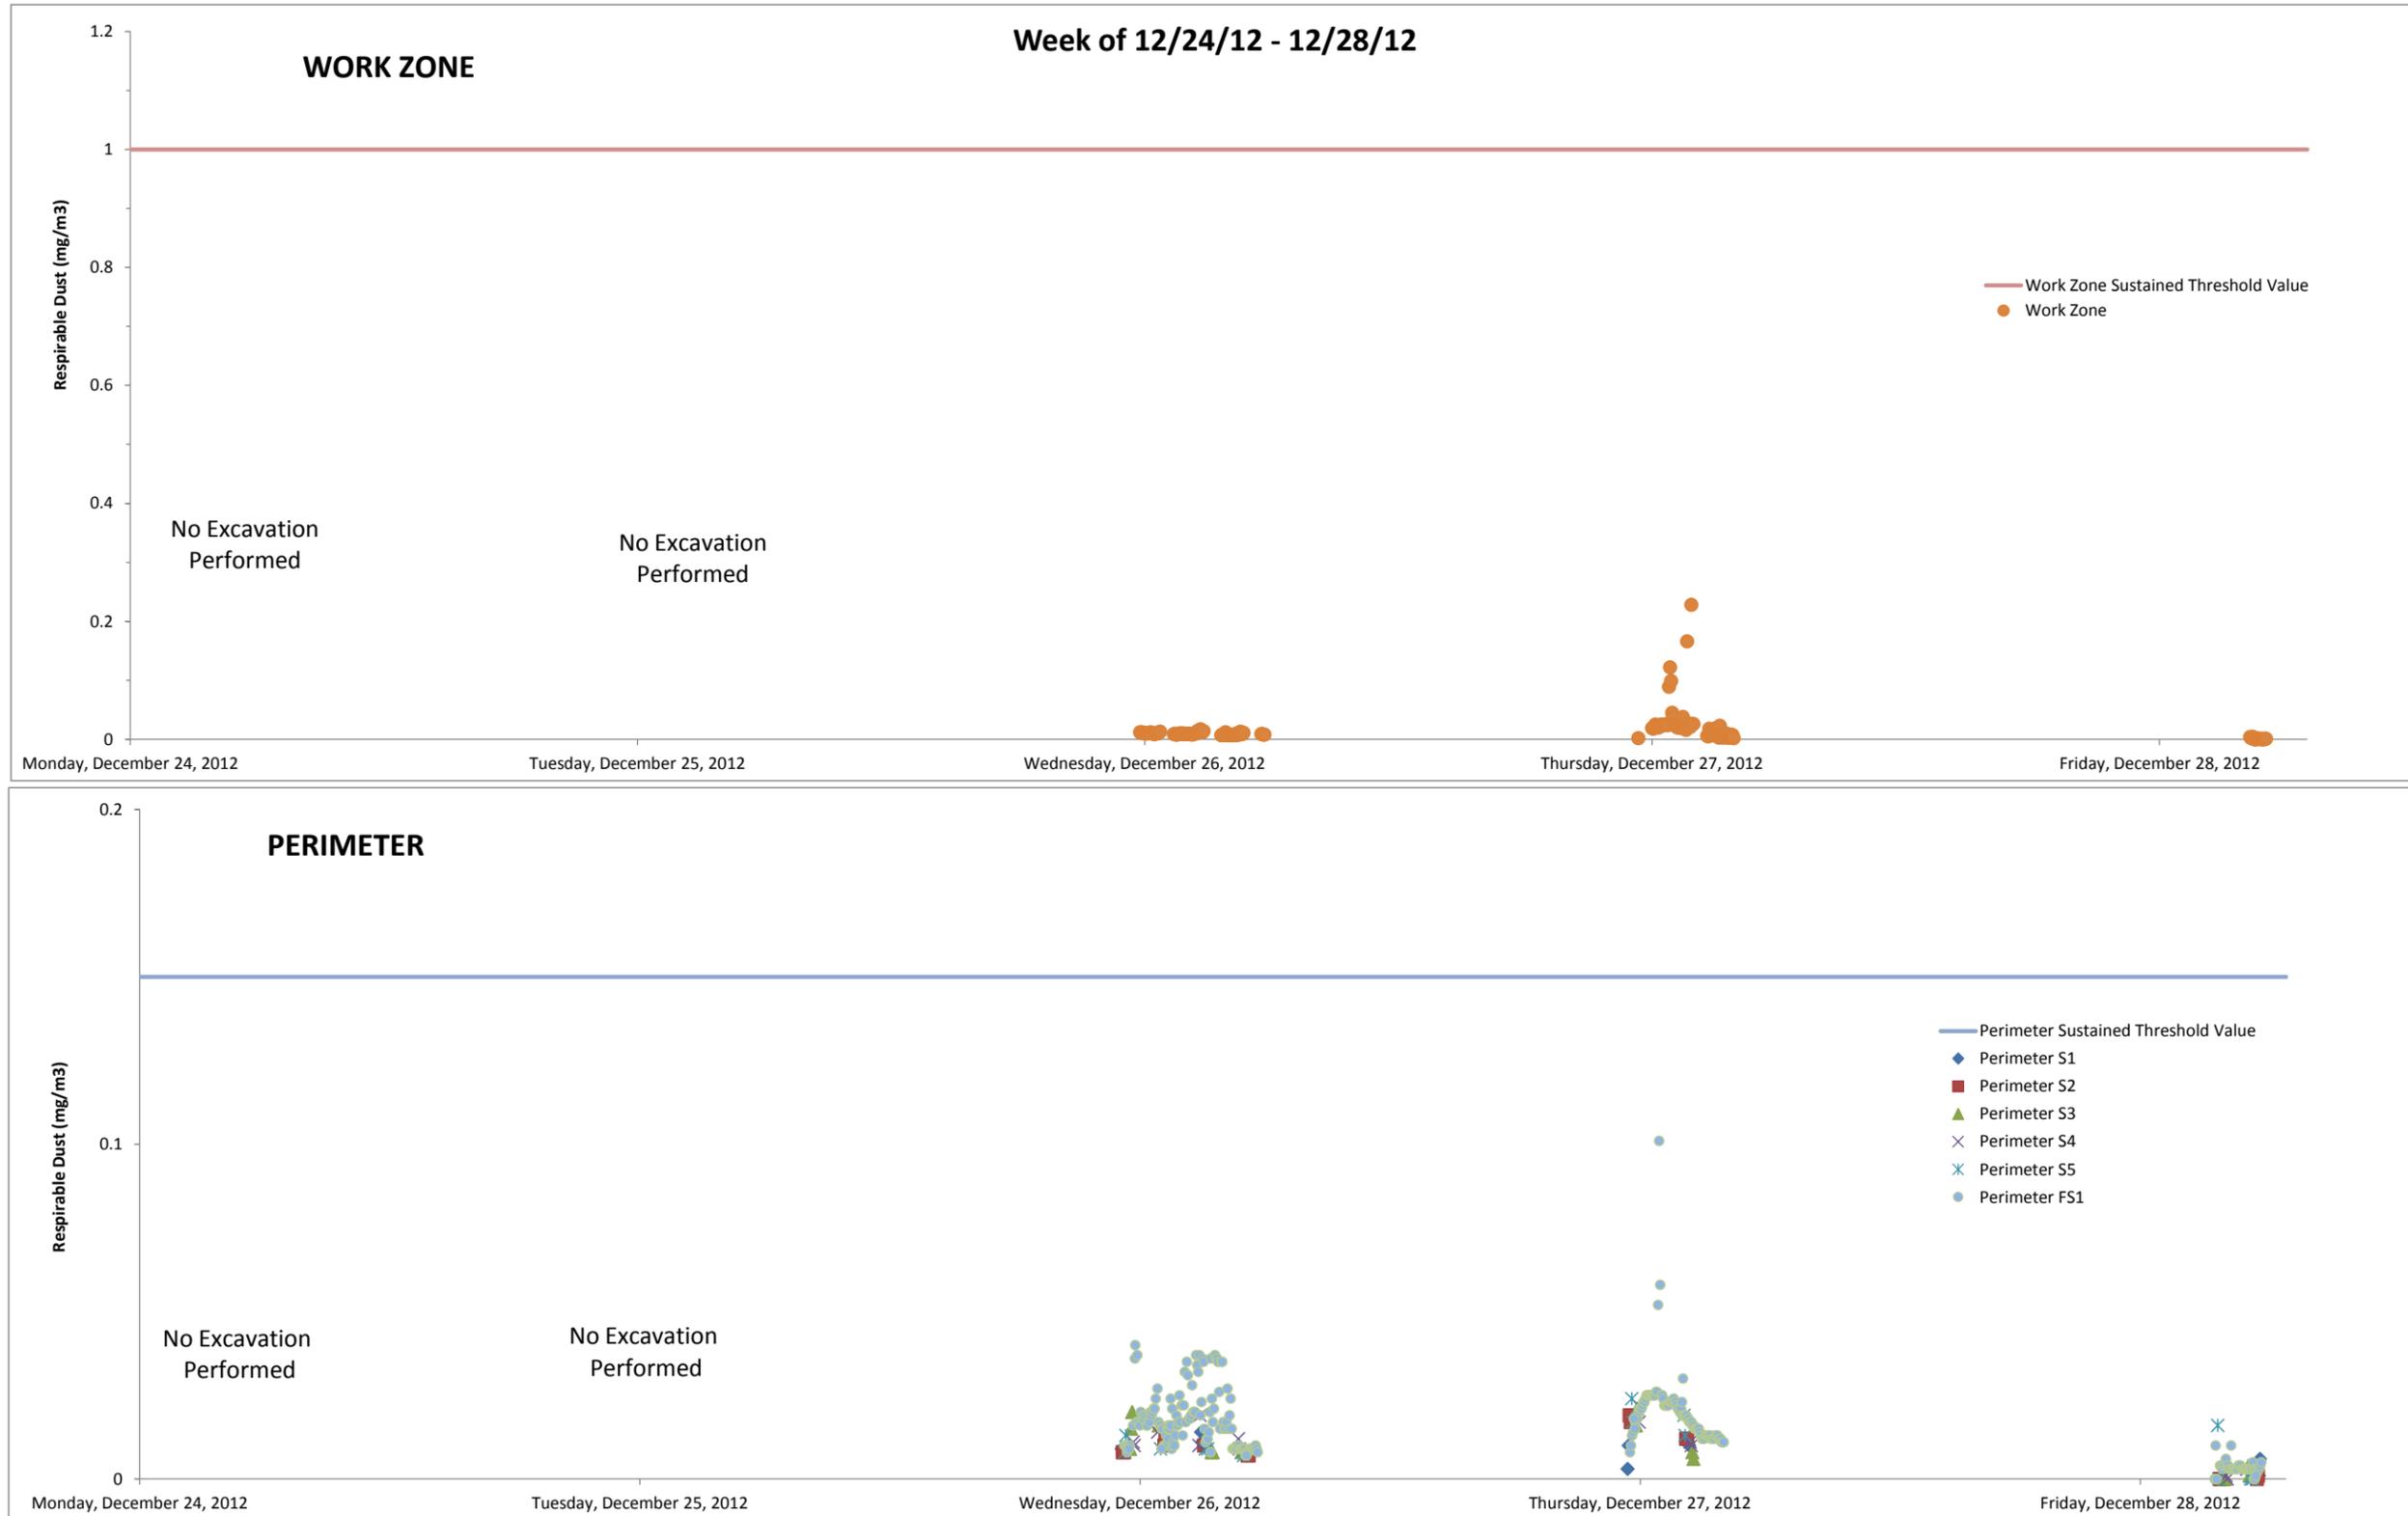


Air Quality Monitoring - Respirable Dust Substation Upgrades, Former Tidewater Facility Pawtucket, Rhode Island

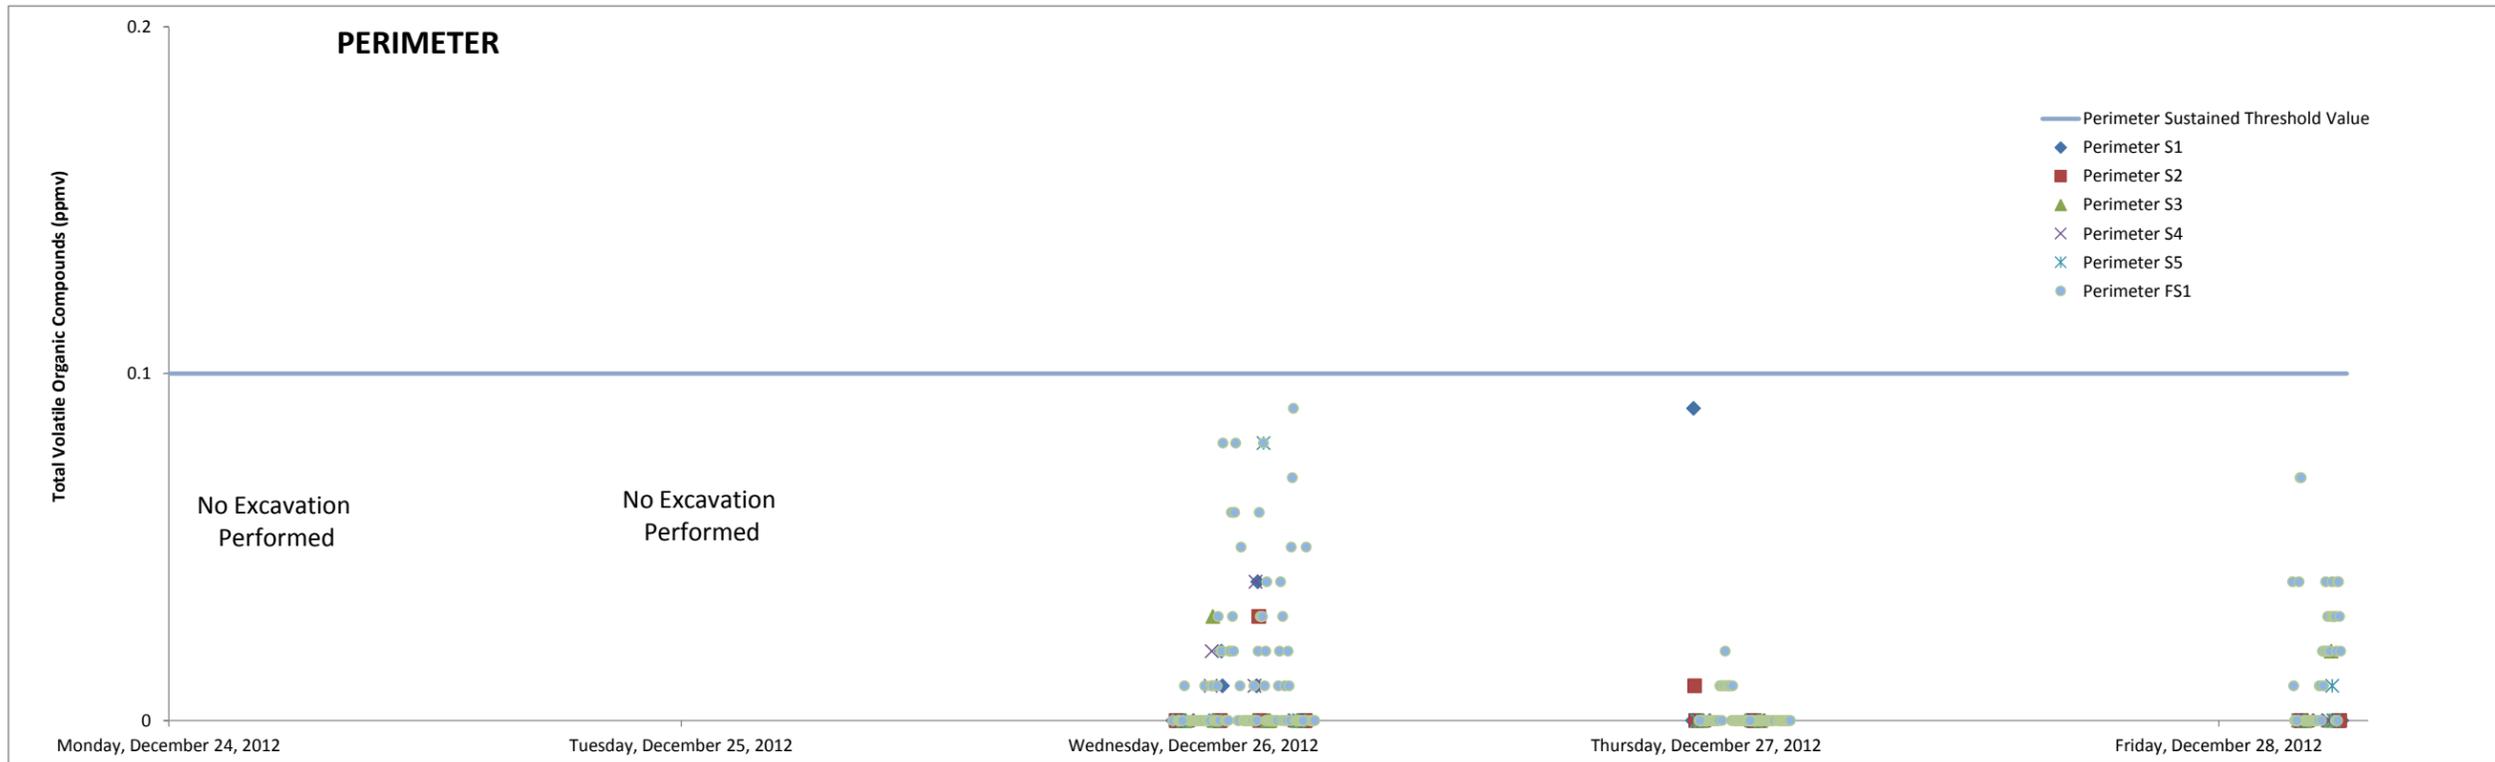

Air Quality Monitoring - TVOCs Substation Upgrades, Former Tidewater Facility Pawtucket, Rhode Island

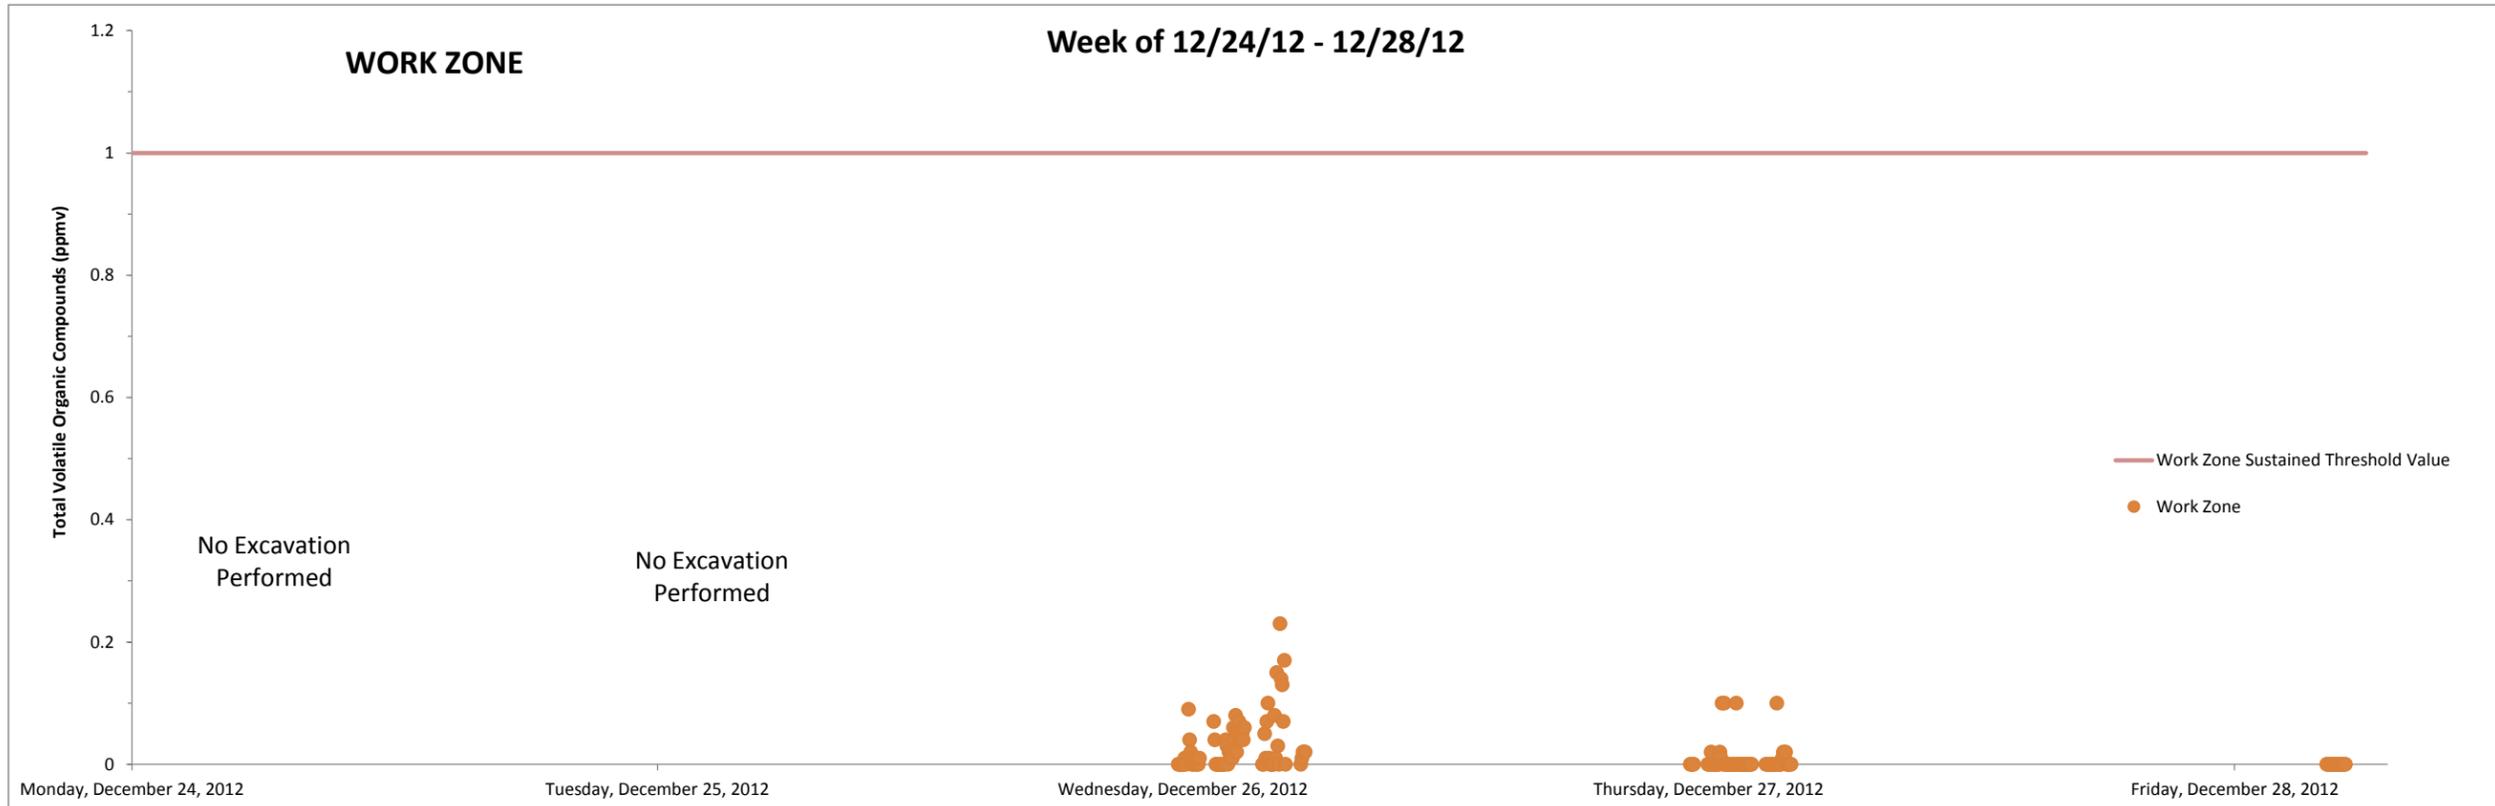

Air Quality Monitoring - Transient Observations
Substation Upgrades, Former Tidewater Facility
Pawtucket, Rhode Island

Date	Time	Location	Constituent	Observed Range of Elevated Transient Readings	Observed Conditions that may be leading to elevated transient readings
No elevated transient readings were observed during this week.					

Transient readings were conducted over a three minute time period. A reading is sustained if it is held for over a five minute time period.